LEGEND

REQ	SYM	DESCRIPTION
2	O	OXYGEN OUTLET
2	A	AIR OUTLET
2	V	VACUUM OUTLET
3	E2	DUPLEX RECEPTACLE, 8300 IVORY, 20A, 125V, H.G., NORMAL POWER
3	E4	DUPLEX RECEPTACLE, 8300 RED, 20A, 125V, H.G., EMER. POWER
1	S5	LOW VOLTAGE MOM CONTACT SWITCH, 1P, 3 POS, CENTER OFF, IVORY
1	NC	NURSE CALL PROVISION
1	AL	AMBIANCE OVERBED LIGHT
1	LV	LOW VOLTAGE SWITCHING PACKAGE

NOTES:

① JUNCTION BOXES: J1--NORMAL POWER, J2--EMERGENCY POWER, J3--LOW VOLTAGE.
② GAS PIPING: TYPE L COPPERTUBING. OXYGEN AND AIR--1/2" I.D., VACUUM--3/4" I.D.
③ WOOD STAIN FINISH: TO BE DETERMINED.

MODULAR SERVICES COMPANY 109 N. E. 38TH STREET OKLAHOMA CITY, OK. 73105

PROJECT

REVISED

AMBIANCE™
PRIVATE PATIENT HEADWALL

SCALE: =1'

DATE	DRAWN BY	DRAWING #
03/21/05		PB-116

MEDIUM ACUITY

__ REQ'D: __ AS SHOWN __ OPPOSITE

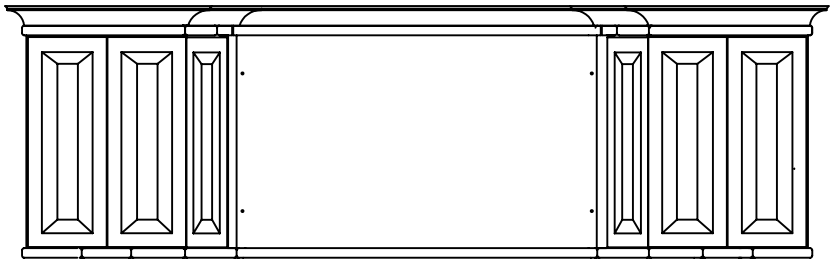

FRONT VIEW WITH DOORS CLOSED

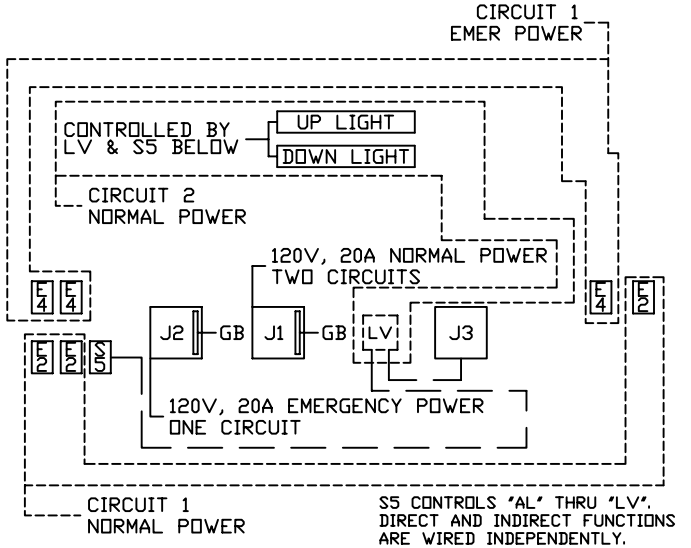

S5 CONTROLS "AL" THRU "LV". DIRECT AND INDIRECT FUNCTIONS ARE WIRED INDEPENDENTLY. UP POSITION CONTROLS INDIRECT. DOWN POSITION CONTROLS DIRECT.

WIRING DIAGRAM
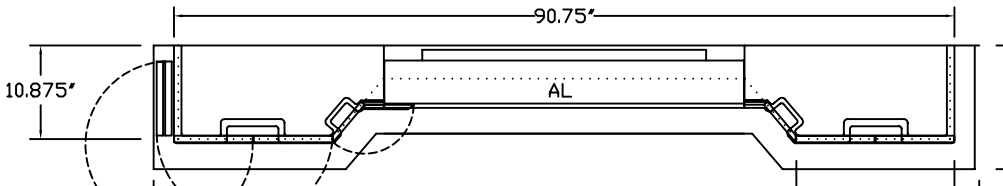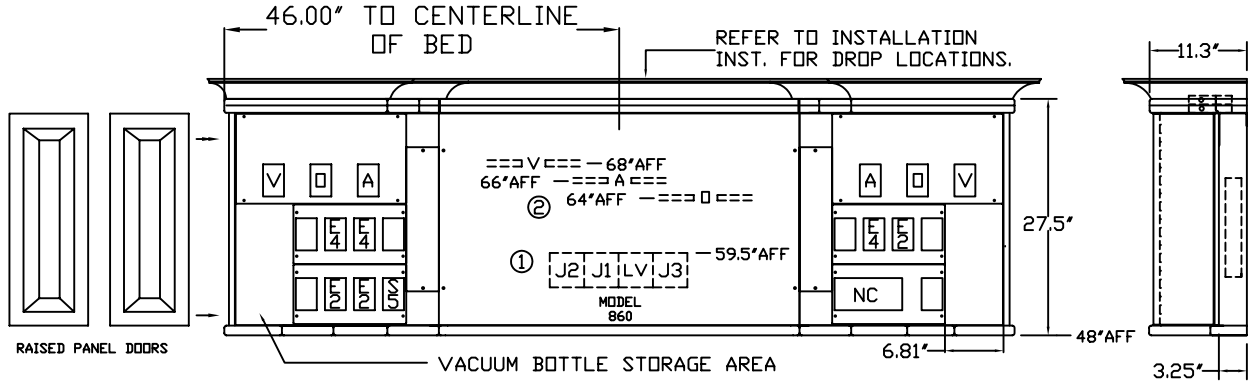
GROUND WIRING TO BE #10 GREEN STRANDED COPPER